


PHAROS INTERIOR



**HARRIE
LEENDERS**

SINCE 1979

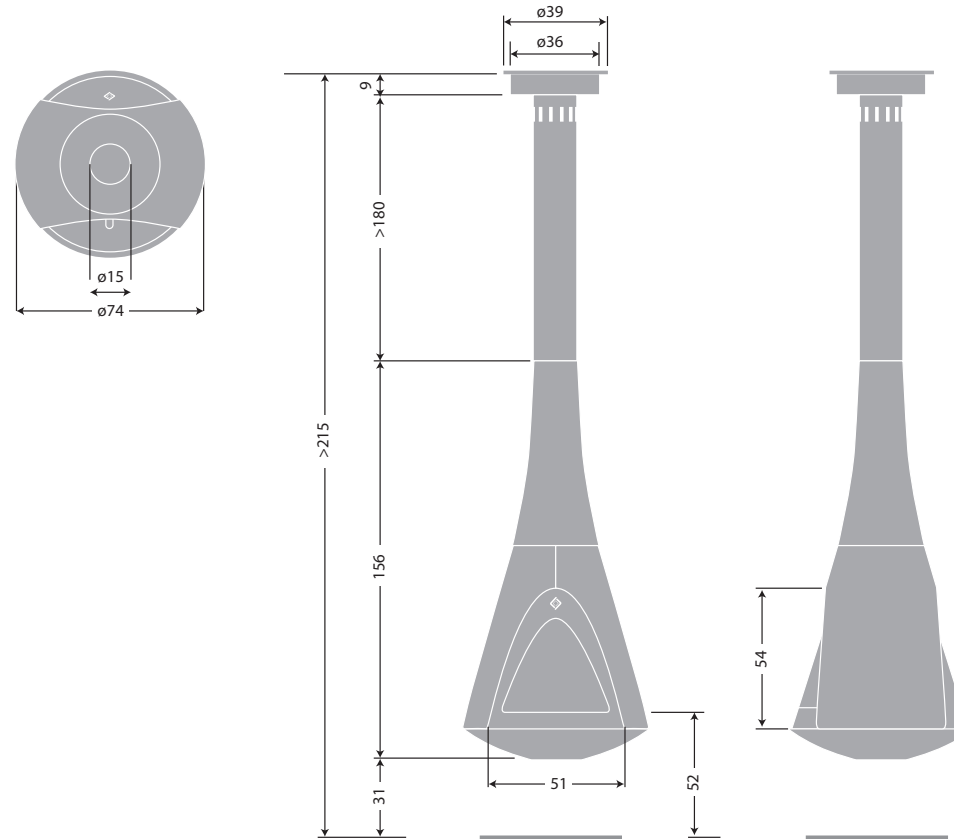

Ø	KG	η	EN 13229	kWh, g/s, CO, mbar
15	125	< 40%	2006PMC/112	9.2, 26.7, 0.207, 0.001